


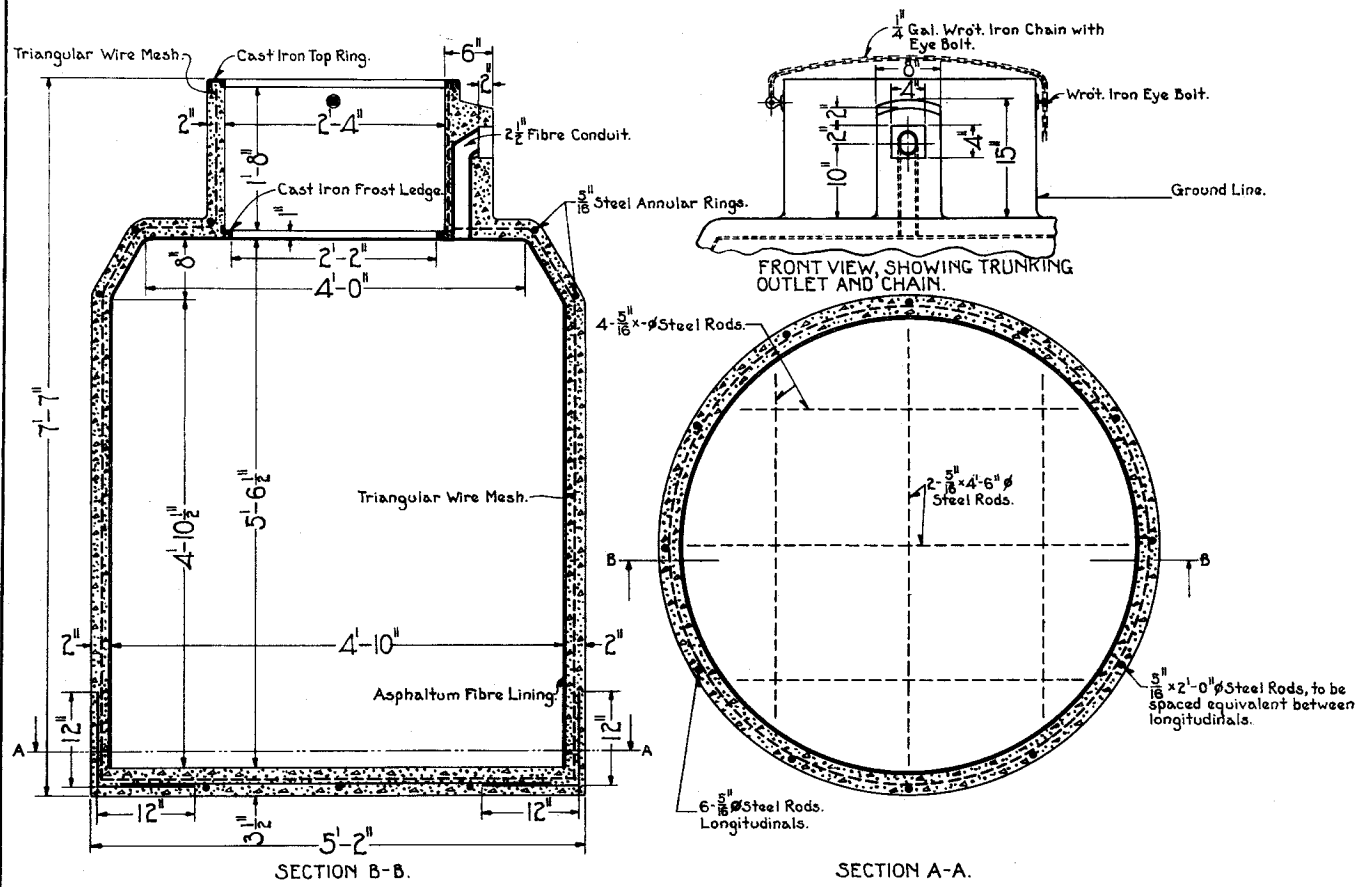

509I-WELL. Max. capacity { 48 Cells 500 A.H.
42 " 1000 "

No. Req.	ASSEMBLAGE NAME.
1	Well Body.
1	Pressed Steel Cover.
1	Eye Bolt with 1-Sq. nut and 2 washers.
1	Chain with Eye Bolt with 1-Sq. nut and 2 washers.
1	Frost Cover.
1	Ladder.
18	Shelf Segments.
18	" Blocks.
18	" Strips.
12	" Uprights.
1	Slat Floor.

Note:-
Battery Well 509I shall be provided with three complete circular shelves with 17" clearance between them, and Slat flooring.

REVISIONS
B- JUNE 12, 1934.
Approved: <i>A. H. P.</i>

absolute

1 SHEET

S-509-B

PENNSYLVANIA SYSTEM

STANDARD BATTERY WELL

OFFICE OF CHIEF SIGNAL ENGINEER, PHILA., PA., SEPT 2, 1921.

Chief Signal Engineer. *A. H. P.*

Chief Engineer. *W. H. P.*