


CURB BOTH SIDES

CONCRETE STATION PLATFORM
Scale - 1/2" = 1'-0"

CURB ONE SIDE

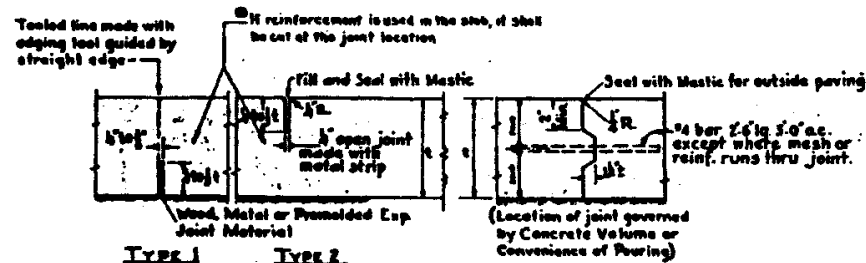

TYPE 1 TYPE 2


DETAIL OF CONTRACTION JOINTS

Spaced 5' to 20' cts. in unreinforced pavements

Type 1 for interior paving
Type 2 - Outside

Note: It is the usual practice to place contraction joints on all column lines, but if the column spacing exceeds 30R, intermediate joints should be provided.

DETAIL OF CONSTRUCTION JOINT AND LONGITUDINAL JOINT

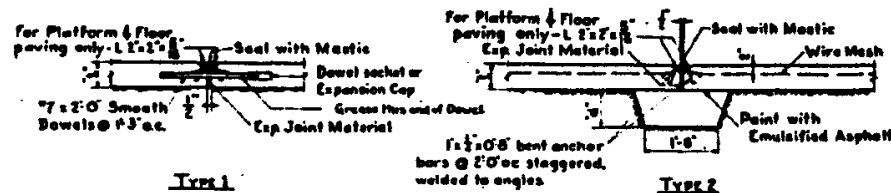

TYPE 1

TYPE 2

DETAIL OF EXPANSION JOINT

Scale 1/2" = 1'-0"

Note: Expansion Joints to be spaced 300' to 600' c.c.

Paving Thickness	4"	6"	Recommended Use
6"	8"	3'-0"	Platform Paving
6"	11"	4'-0"	Roadway Paving

Concrete Floors On Ground

1/2" joint filler

Trowel finish & cover with mastic.


2" Bituminous wearing surface placed on 6" bed of well compacted cinders or gravel.

Concrete Paving where specified.

SECTION - GRAVITY CURB

Scale - 1/2" = 1'-0"


M	A	B	C	Reinforcement
3'-0"	2'-0"	1'-0"	0'-0"	5/8" x 12" ss
3'-0"	2'-0"	1'-0"	0'-0"	5/8" x 12" ss
3'-0"	2'-0"	1'-0"	0'-0"	5/8" x 12" ss
3'-0"	2'-0"	1'-0"	0'-0"	5/8" x 12" ss
3'-0"	2'-0"	1'-0"	0'-0"	5/8" x 12" ss
3'-0"	2'-0"	1'-0"	0'-0"	5/8" x 12" ss
3'-0"	2'-0"	1'-0"	0'-0"	5/8" x 12" ss
3'-0"	2'-0"	1'-0"	0'-0"	5/8" x 12" ss
3'-0"	2'-0"	1'-0"	0'-0"	5/8" x 12" ss
3'-0"	2'-0"	1'-0"	0'-0"	5/8" x 12" ss

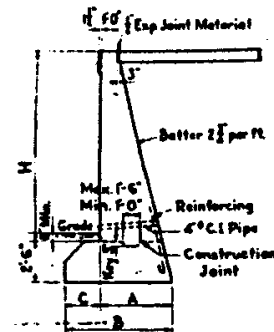

TYPICAL DETAILS - RETAINING WALLS


Scale - 1/2" = 1'-0"

NOTE: Paving to be increased in thickness as shown below at all unsupported edges.




SECTION ALONG CURB

Scale 1/2" = 1'-0"

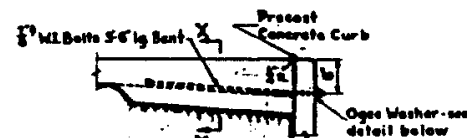

SECTION THROUGH CURB ANCHOR

Scale 1/2" = 1'-0"

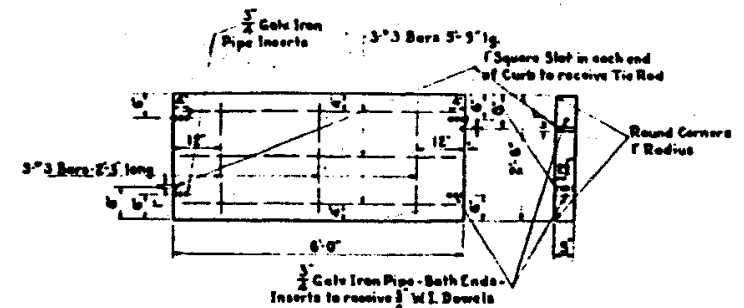

DETAIL OF PRECAST CONCRETE CURB

Scale - 1/2" = 1'-0"



SECTION X-X

Scale 1/2" = 1'-0"



DETAIL - OGEE WASHER

Scale 1/2" = 1'-0"

3" W.I. bolts 3'-6" lg. bent in field. Bolts to receive a thick coat of approved Asphalt Paint and wrapped with impregnated fabric, or encased in 3" of concrete.

2" Bituminous wearing surface placed on 6" bed of well compacted cinders or approved granular material.

Concrete Anchor for Tie Rods 12" x 6" x 12"

Precast Concrete Curb 6'-0" long

DETAIL - BITUMINOUS SURFACE PAVING

Scale 1/2" = 1'-0"

NOTES:

- 1-Concrete to be W₆ as per P.R.R. Specs. C.E. 77(1), with an approved or entraining agent added at mixer to entrain 3% air.
- 2-Wire Mesh Reinforcement to be 4" x 4" Mesh No. 10 Wire for Platform Paving and 6" x 6" Mesh No. 6 Wire for Roadway Paving.
- 3-Mastic as per A.R.E.A. Spec. for asphalt seeping.
- 4-Expansion Joint Material as per A.R.E.A. Specs.
- 5-Impregnated Fabric as per A.R.E.A. Specs.
- 6-Bituminous Wearing Surface to be as per P.R.R. Special Specification, or other approved standard.

REVISIONS	SHEET NO. 1	388350
Revisions: 1. Rev. 10-1-34 2. Rev. 10-1-34 3. Rev. 10-1-34 4. Rev. 10-1-34 5. Rev. 10-1-34 6. Rev. 10-1-34 7. Rev. 10-1-34 8. Rev. 10-1-34 9. Rev. 10-1-34 10. Rev. 10-1-34	THE PENNSYLVANIA RAILROAD TYPICAL PLATFORM DETAILS Office of Engineer of Bridges & Buildings Philadelphia, Pa. October 30, 1934. Approved: <i>[Signature]</i> Engineer of Bridges & Bldgs.	